


**SOUTHERN NEVADA HEALTH DISTRICT
TYPICAL PLOT PLAN
FOR
INDIVIDUAL SEWAGE DISPOSAL SYSTEM (ISDS)**

Scale
(1" = 20')

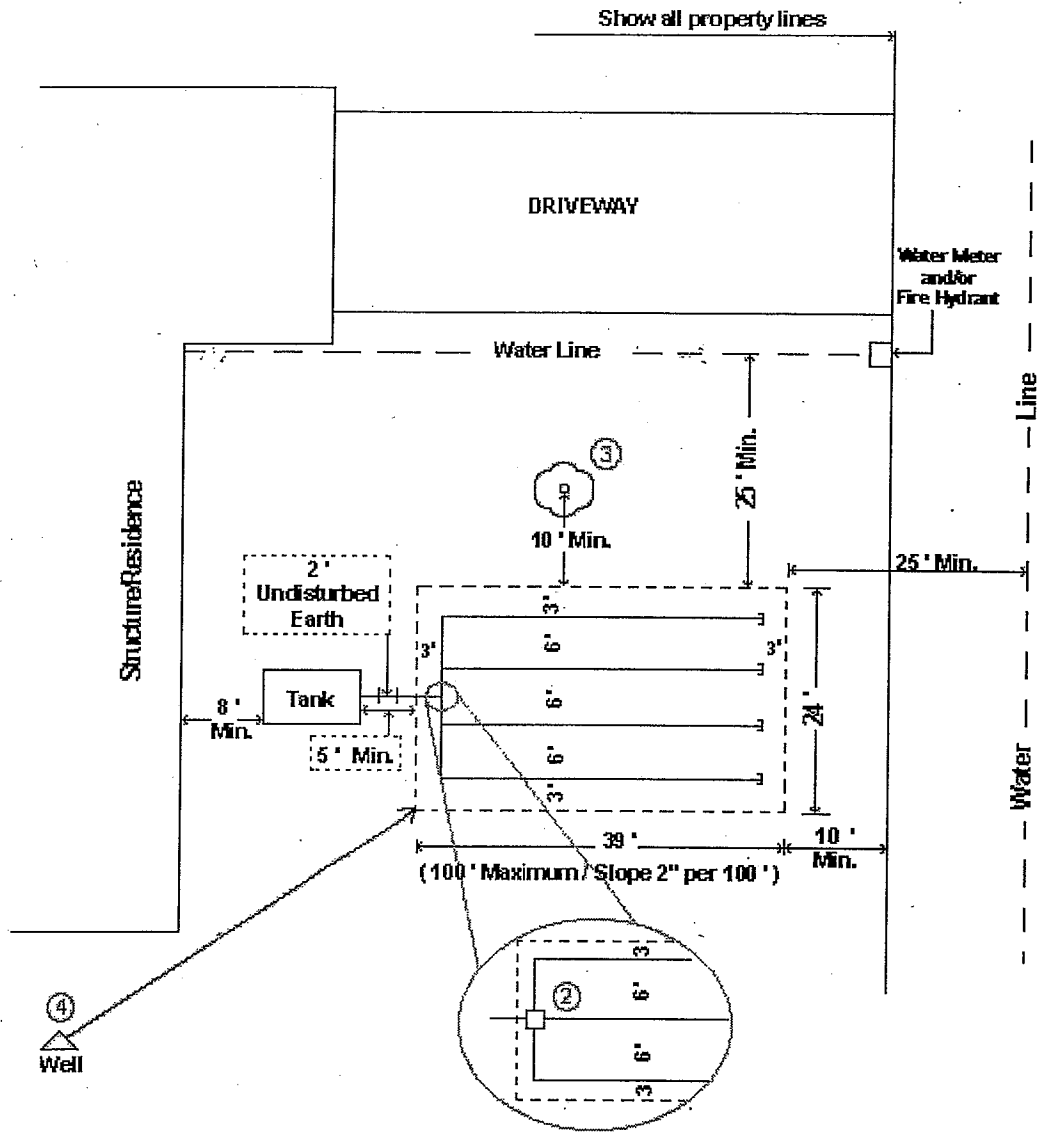


- 1 All plot plans submitted must be **drawn to scale**. (Engineering or Architectural)
- 2 A **Distribution Box** is required with any ISDS greater than 2000 gallons or a system utilizing an odd number of leach lines or trenches. (Inlet hole will be higher than the outlet holes.)
- 3 **No trees** within ten (10) feet of any portion of ISDS.
- 4 Shallow septic systems must be a minimum of 100 feet from all wells. Deep soil absorption systems must be a minimum of 150 feet from all wells.



NO paving and No vehicular traffic allowed over the ISDS

(SEE REVERSE SIDE)

CLARK COUNTY HEALTH DISTRICT
INDIVIDUAL SEWAGE DISPOSAL SYSTEM

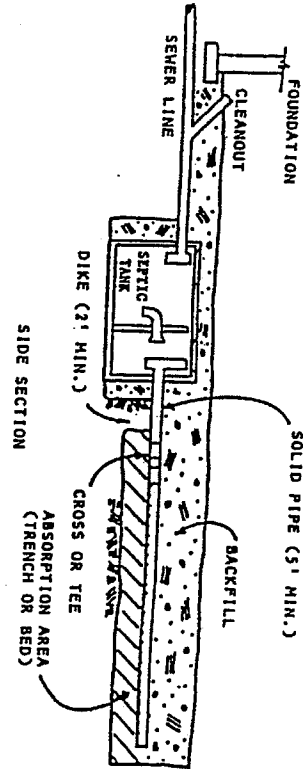

RECOMMENDED SCHEDULE OF SEPTIC TANK INSIDE DIMENSIONS				
CAPACITY GALLONS	TANK WIDTH	TANK LENGTH	LIQUID DEPTH	TOTAL DEPTH
1000	4' - 0"	8' - 0"	4' - 6"	5' - 6"
1200	4' - 6"	8' - 6"	4' - 6"	5' - 6"
1500	4' - 6"	10' - 0"	4' - 6"	5' - 6"
2000	5' - 6"	11' - 0"	4' - 6"	5' - 6"
2250	5' - 6"	11' - 0"	5' - 0"	6' - 0"
2500	6' - 0"	12' - 0"	4' - 9"	6' - 0"

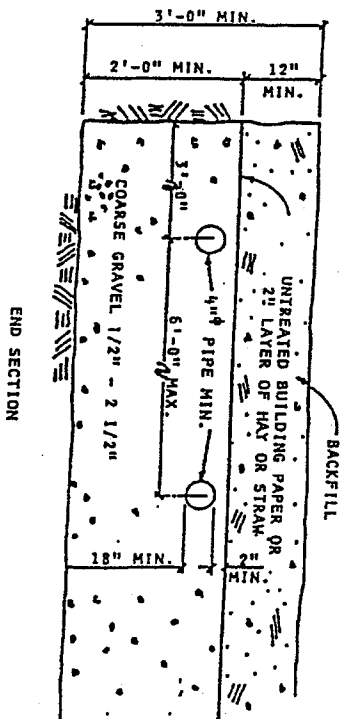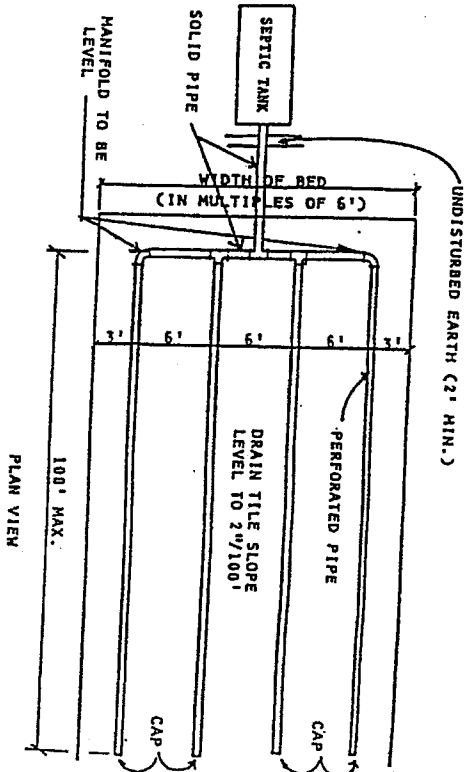

TYPICAL SEEPAGE BED